



ESTABLISHED 1907

**Muswellbrook Coal Company Limited**

**Spontaneous Combustion Report**

**For: Environmental Protection Licence 656**

**Reporting Period: April 2021**

**Authority Holder: Muswellbrook Coal Company Limited**

**Report Date: 13 May 2021**

**Approved by: Brooke York  
Environmental Superintendent**



## Table of Contents

<b>1.0 INTRODUCTION.....</b>	<b>1</b>
<b>2.0 SPONTANEOUS COMBUSTION MANAGEMENT MEASURES.....</b>	<b>1</b>
<b>3.0 GAS MONITORING RESULTS.....</b>	<b>4</b>
<b>4.0 RESPONSE TO ELEVATED GAS LEVELS .....</b>	<b>12</b>
<b>5.0 CORRELATION BETWEEN MANAGEMENT ACTIVITIES AND GAS LEVELS .....</b>	<b>12</b>
<b>6.0 CORRELATION BETWEEN COMMUNITY COMPLAINTS AND GAS LEVELS.....</b>	<b>12</b>

## List of Tables

Table 1: Spontaneous Combustion Management Measures .....	1
Table 2: Classification of Spontaneous Combustion Outbreaks.....	3
Table 3: Summary of Spontaneous Combustion .....	3
Table 4: Data Capture Rates .....	4

## List of Figures

Figure 1: Location of Spontaneous Combustion Outbreaks in Open Cut 1.....	5
Figure 2: Location of Spontaneous Combustion Outbreaks in Open Cut 2.....	6
Figure 3: Hydrogen Sulphide 30 Minute Results .....	7
Figure 4: Sulphur Dioxide 1 Hour Results .....	8
Figure 5: Hydrogen Sulphide 1 Hour Results .....	9
Figure 6: Sulphur Dioxide 24 Hour Results .....	10
Figure 7: Hydrogen Sulphide 24 Hour Results .....	11



## 1.0 INTRODUCTION

The coal seams mined by the Muswellbrook Coal Company (MCC) operations are the Greta Coal Measures. These measures have a history of spontaneous combustion. Spontaneous combustion has been a long-term issue at MCC since the first operation commenced in 1907.

A Spontaneous Combustion Management Plan (SCMP) has been prepared according to the specific requirements of the Development Consent. The main objective of the SCMP is to minimise the occurrence of spontaneous combustion and manage the effect by identification, control, removal, mitigation and prevention in the following areas:

- Existing open cut and underground workings;
- Drilling and blasting;
- Mining of overburden;
- Mining of coal;
- Emplacement of overburden;
- Emplacement of washery reject; and
- Coal stockpiles.

The Environment Protection Authority (EPA) require MCC to provide reports on spontaneous combustion management and monitoring on a monthly basis. This report identifies:

- Spontaneous combustion management during the reporting period;
- Gas monitoring results;
- Number of complaints relating to spontaneous combustion;
- Response to hydrogen sulphide levels above the odour threshold; and
- Correlation between spontaneous combustion on site with gas results and complaints received.

## 2.0 SPONTANEOUS COMBUSTION MANAGEMENT MEASURES

The daily spontaneous combustion management measures for the reporting period are shown in **Table 1**.

**Table 1: Spontaneous Combustion Management Measures**

Date	Water Sprays	Water Carts Assisting	Capping	Hot Material Removal	Comments
01/04/21	-	OC1	-	-	
02/04/21	-		-	-	
03/04/21	-	OC1	-	-	
04/04/21	-	OC1	-	-	
05/04/21	-	OC1	-	S23	
06/04/21	-	OC1	-	-	
07/04/21	-	OC1	-	-	Wet Weather
08/04/21	S23	OC1	-	-	Wet Weather
09/04/21	S23	OC1	-	-	



Date	Water Sprays	Water Carts Assisting	Capping	Hot Material Removal	Comments
10/04/21	S23	OC1	-	-	
11/04/21	-	OC1	-	-	
12/04/21	-	S23	-	-	
13/04/21	-	OC1	-	S23/S24	
14/04/21	-	S24	-	S23	Wet Weather
15/04/21	S23	S24	S23	S23	
16/04/21	S23	S24	-	-	
17/04/21	S23	OC1	-	-	Wet Weather
18/04/21	S23	OC1	-	-	
19/04/21	S23	OC1	-	-	
20/04/21	S23	OC1	-	-	
21/04/21	S23	OC1	-	-	
22/04/21	S23	OC1	-	-	
23/04/21	S23	S23	S23/S22	-	
24/04/21	-	S23/S24	S22	S22	
25/04/21	-	S22/S23	S22	S23	
26/04/21	-	OC1	S22	S24	
27/04/21	-	OC1	-	-	
28/04/21	S23	OC1	-	-	Wet Weather
29/04/21	-	OC1	-	S23	Wet Weather
30/04/21	-	S24	-	-	

The classification system for spontaneous combustion outbreaks is provided in **Table 2**. A summary of the areas affected by spontaneous combustion and the areas controlled and treated during the reporting period is provided in **Table 3**. The locations of these areas can be seen in **Figure 1** to **Figure 2**.

**Table 2: Classification of Spontaneous Combustion Outbreaks**

Classification	Description
A	Open flame
B	Visible steam or smoke
C	Other physical evidence of spontaneous combustion (e.g. cracks, coal tars, sulphur crusting, etc)

\* - classification revised in November 2019

**Table 3: Summary of Spontaneous Combustion**

Site Map Location	Classification (A-C)	Affected Area Without Active Control ( $m^2$ )	Active Controls Completed	Area Controlled ( $m^2$ )
Open Cut 1	A	4*	Mining	3,600**
	B	50*	Capping	24**
	C	30*	Infusion	8,600**
Open Cut 2	N/A	0*	None Required	0**
<b>SUMMARY</b>				
Total Area Affected		84*		
Total Area Controlled		12,224**		

\* - at end of reporting period

\*\* - during reporting period

No spontaneous combustion outbreaks were observed in Open Cut 2 throughout April 2021. Therefore, no active controls were implemented in Open Cut 2.

### 3.0 GAS MONITORING RESULTS

The gas monitoring results are displayed graphically in **Figure 3** to **Figure 7**. As noted in these graphs, there were no results above the health impact assessment criteria for the reporting period.

The data capture rates for the reporting period and the last 12 months are shown in **Table 4**.

**Table 4: Data Capture Rates**

<b>Monitoring Location</b>	<b>Pollutant</b>	<b>Averaging Period</b>	<b>Data Capture – April (%)</b>	<b>Data Capture – 12 Month Rolling (%)</b>
Point 9, Nisbet	Hydrogen Sulphide	30 minutes	95.9	92.0
		1 hour	94.9	90.9
		24 hours	100.0	95.3
Point 10, Muscle Creek	Hydrogen Sulphide	30 minutes	97.8	96.2
		1 hour	95.6	95.1
		24 hours	100.0	99.7
Point 15, Nisbet	Sulphur Dioxide	1 hour	95.7	91.6
		24 hours	100.0	95.9
Point 16, Muscle Creek	Sulphur Dioxide	1 hour	95.4	95.1
		24 hours	100.0	99.7

Data capture for all monitoring sites was 90% or higher during April 2021.

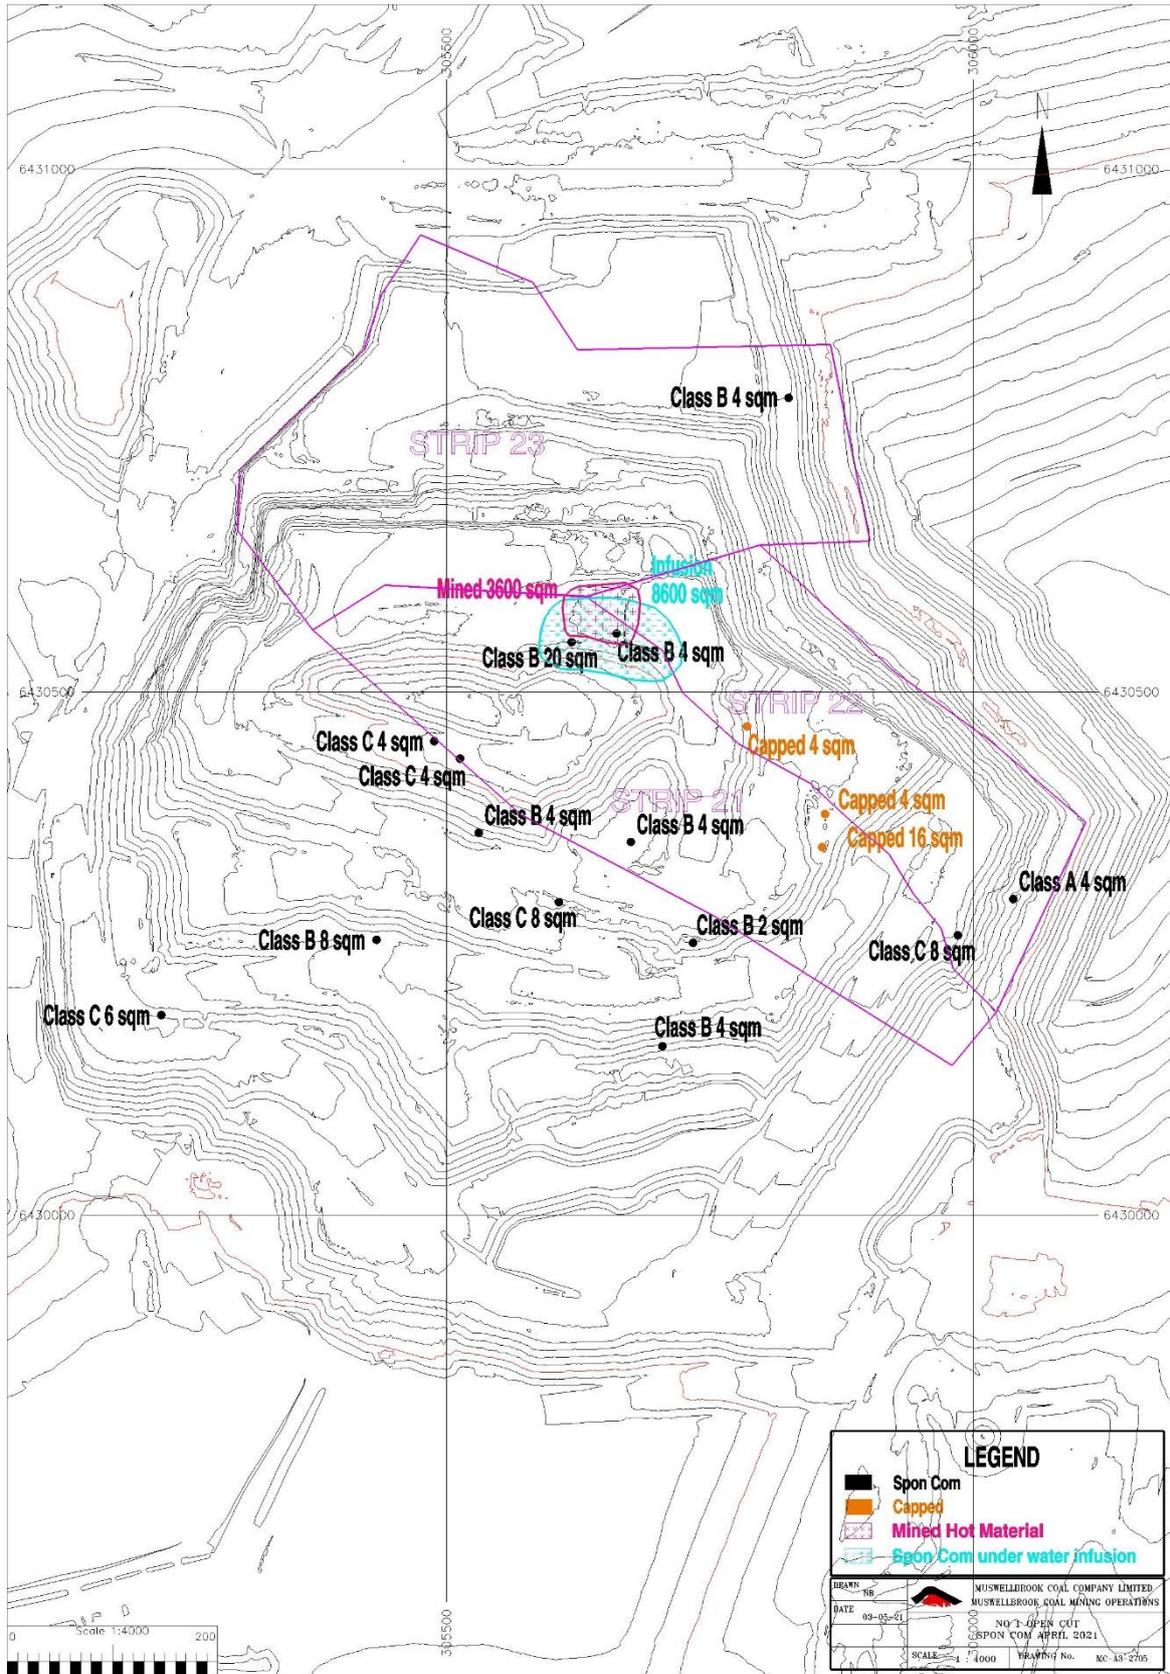


Figure 1: Location of Spontaneous Combustion Outbreaks in Open Cut 1

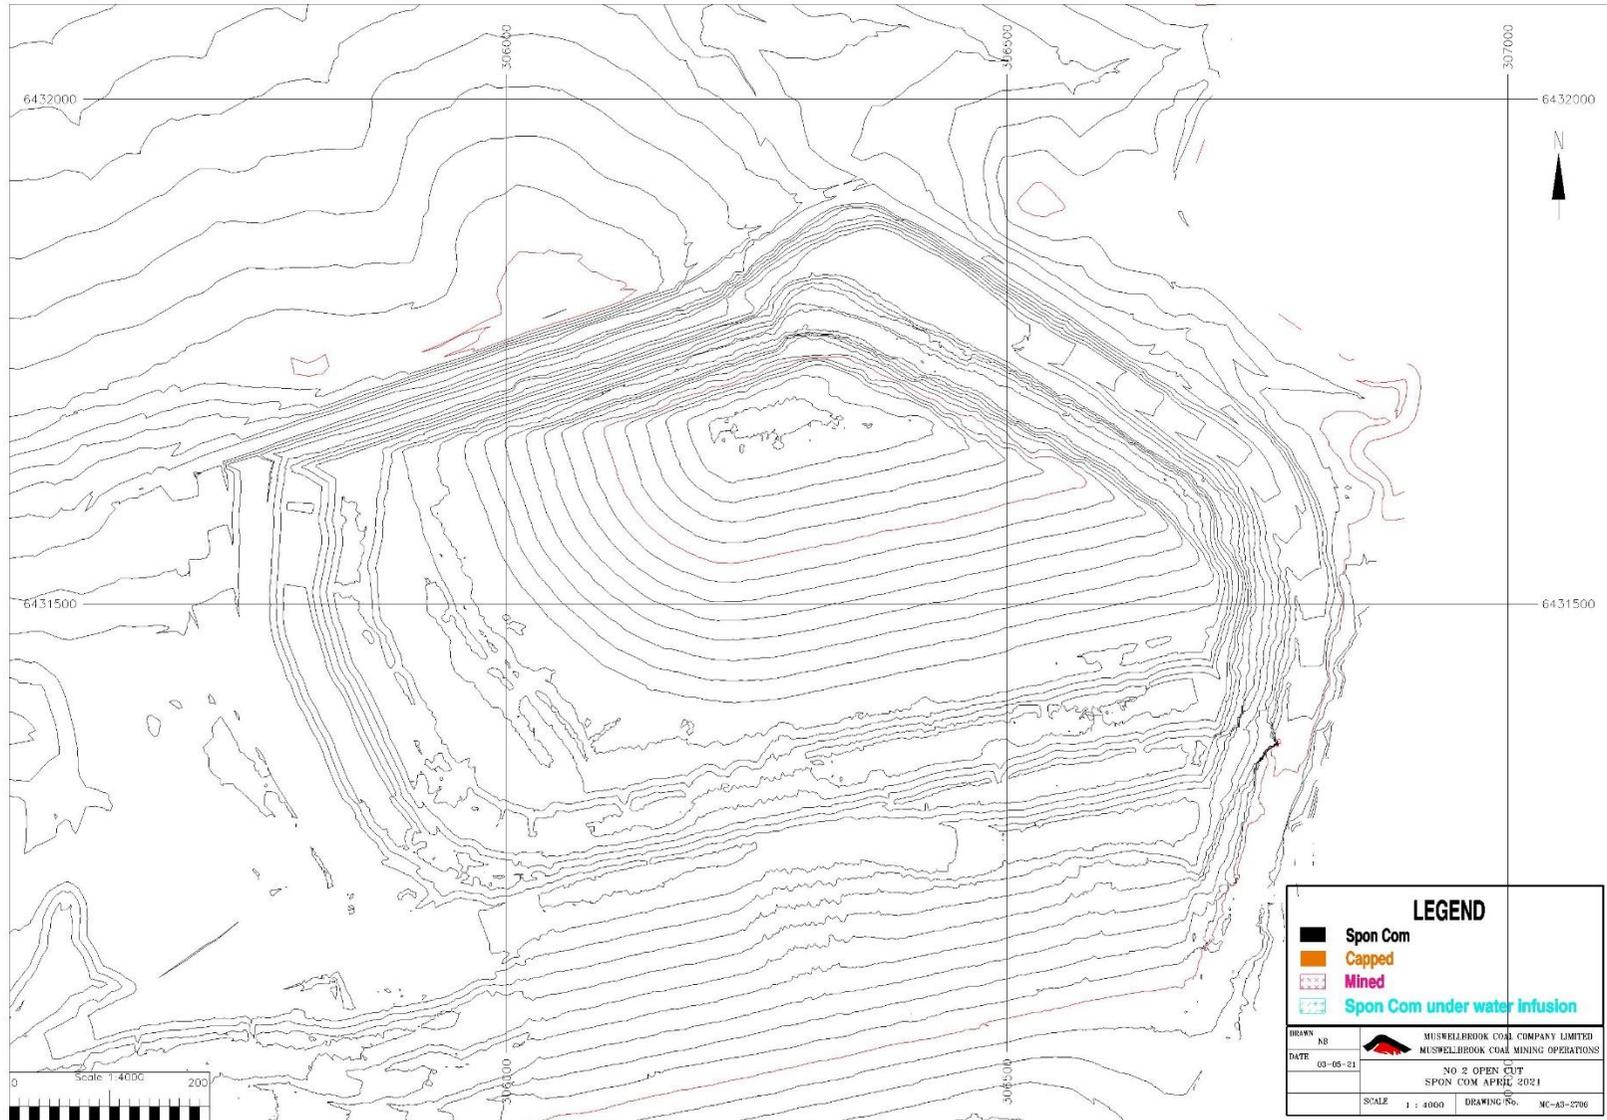


Figure 2: Location of Spontaneous Combustion Outbreaks in Open Cut 2

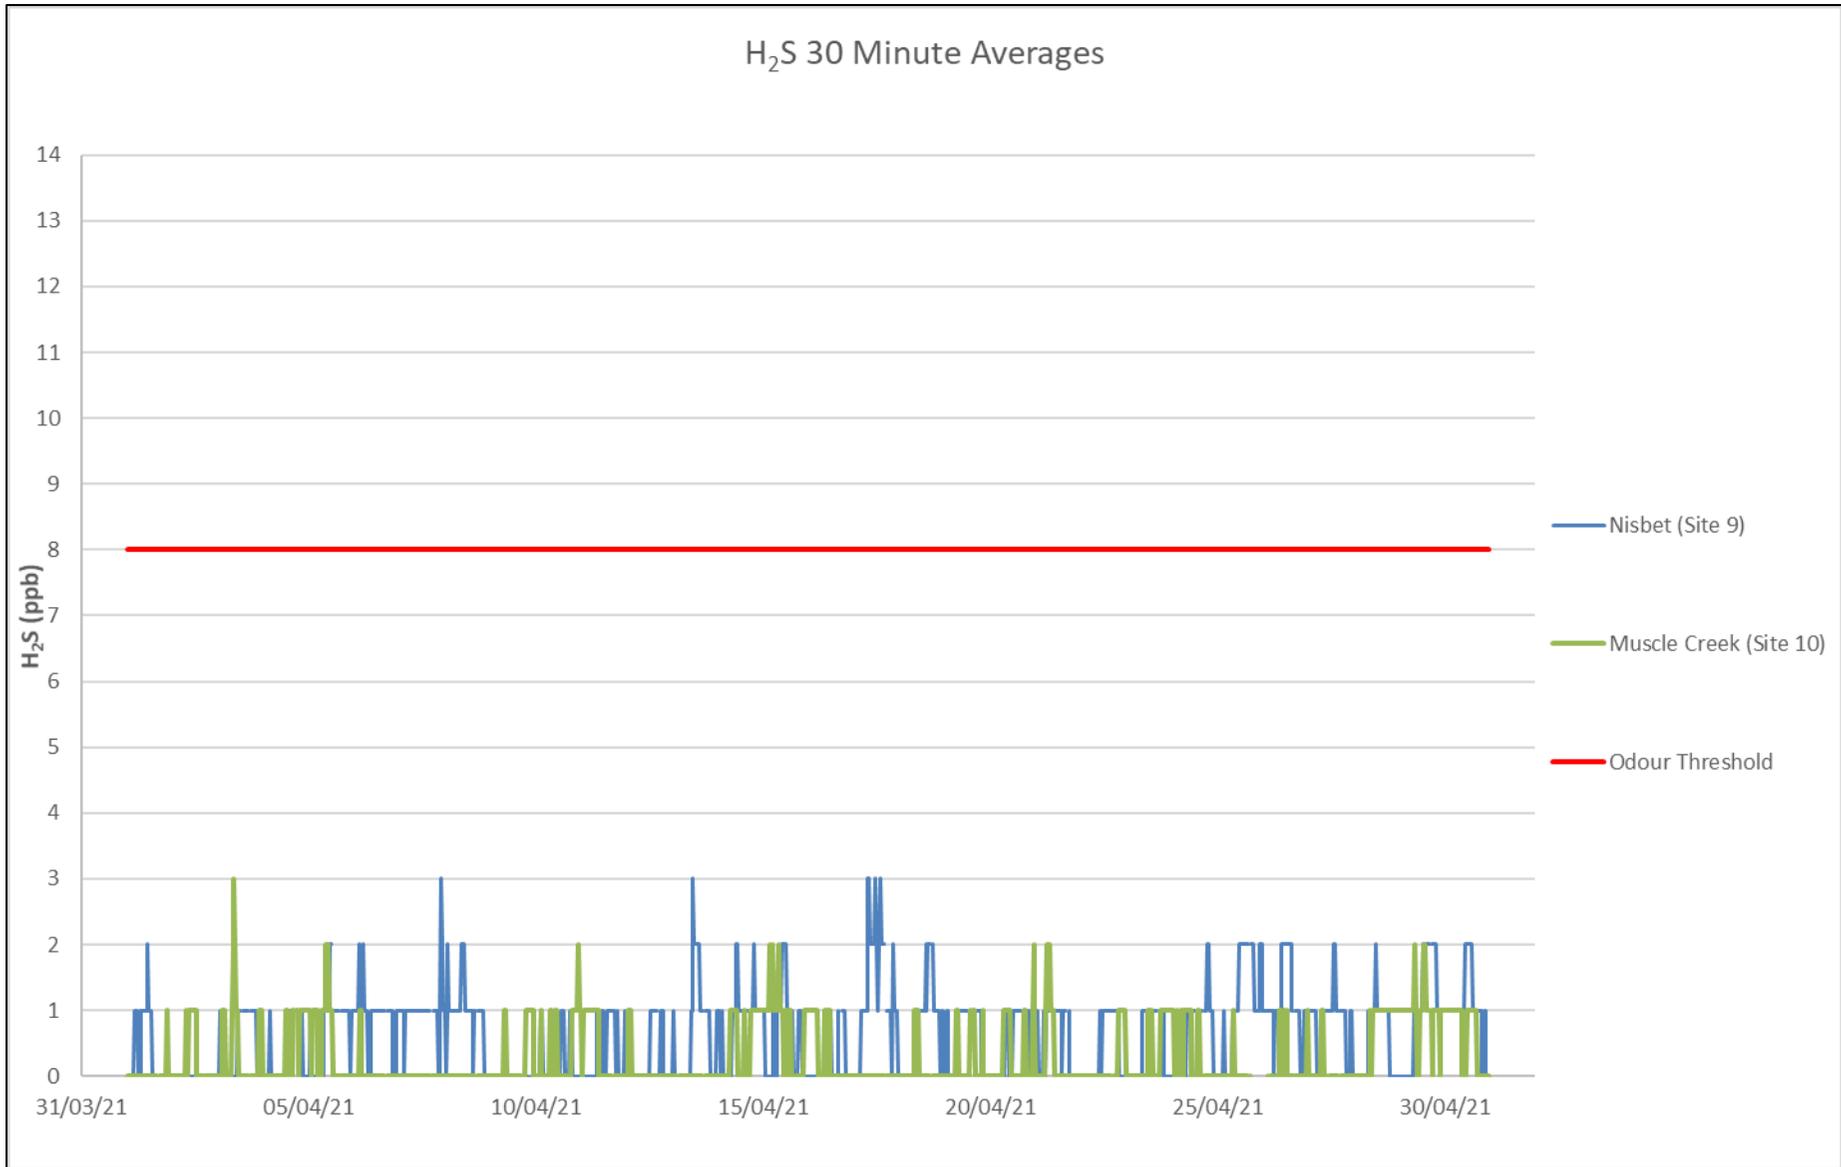


Figure 3: Hydrogen Sulphide 30 Minute Results

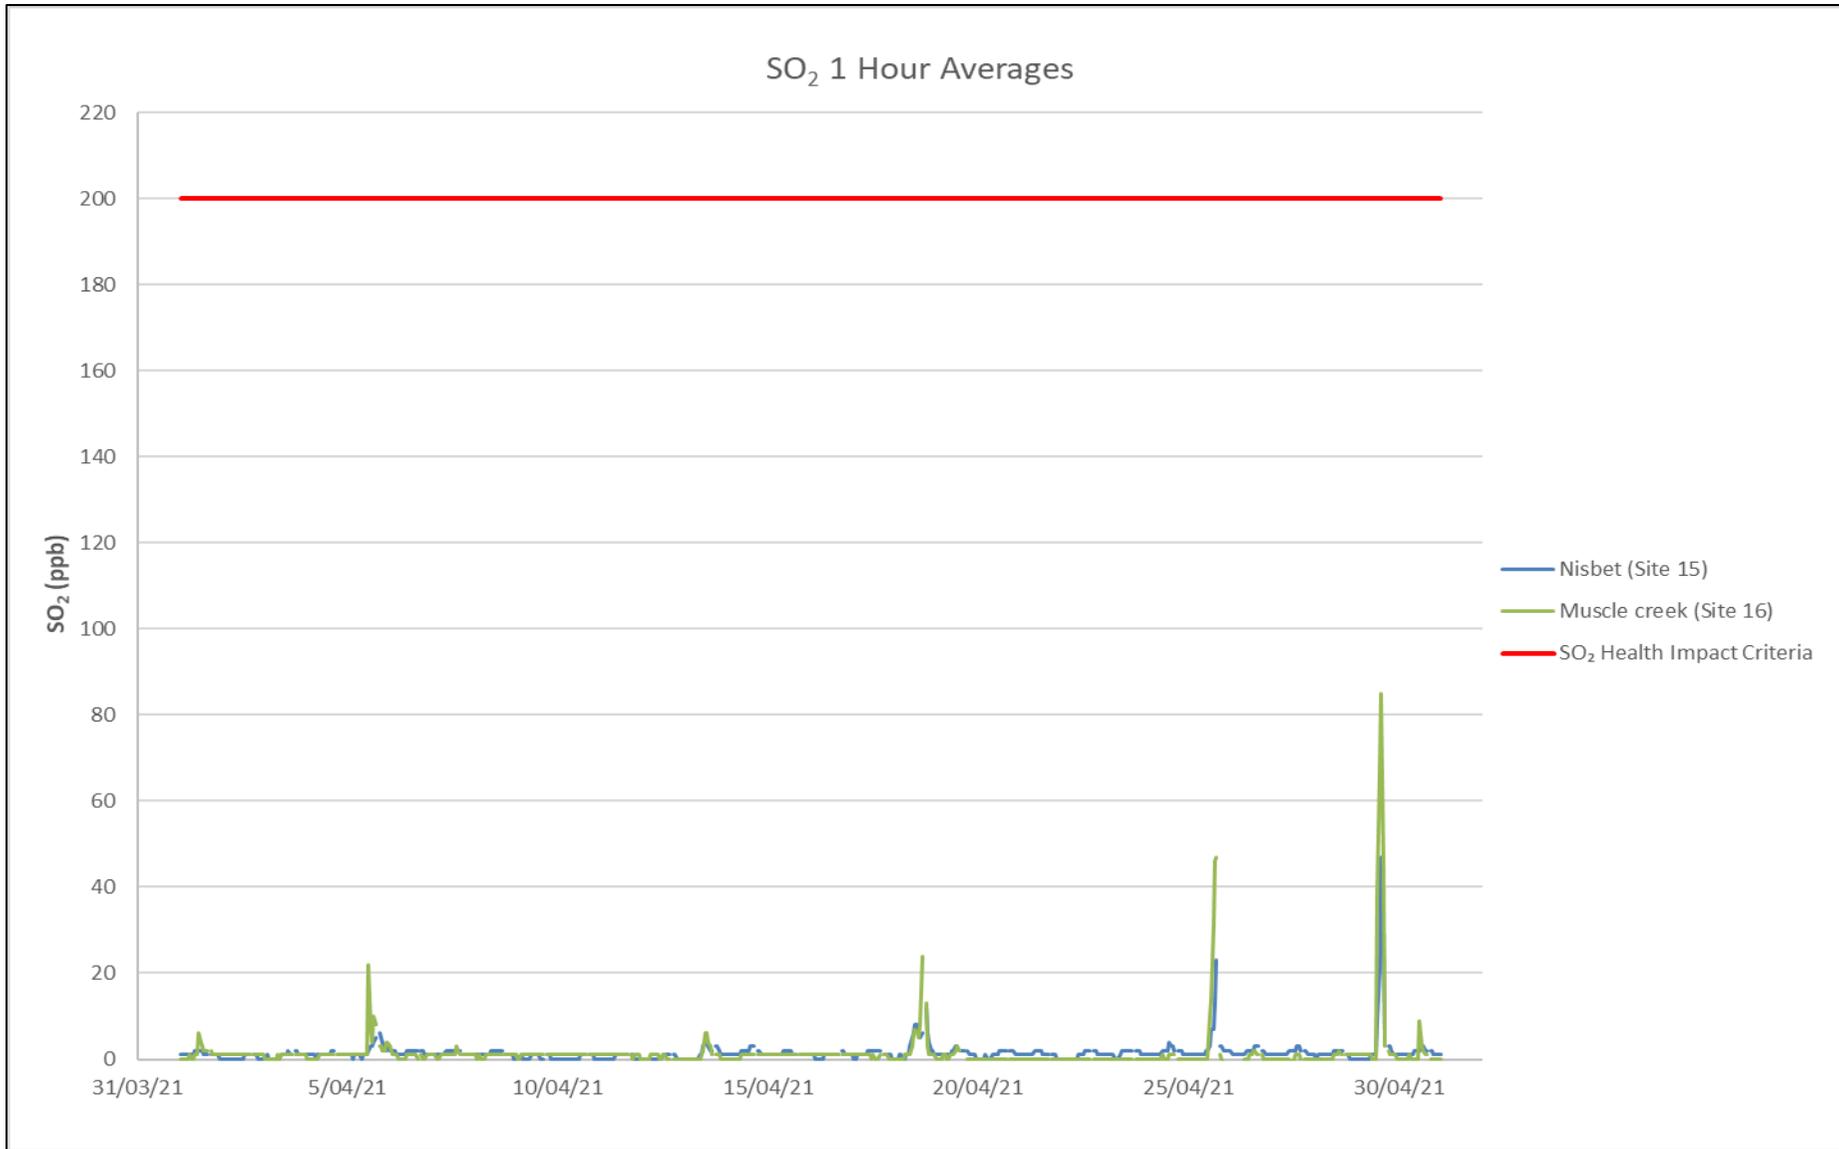


Figure 4: Sulphur Dioxide 1 Hour Results

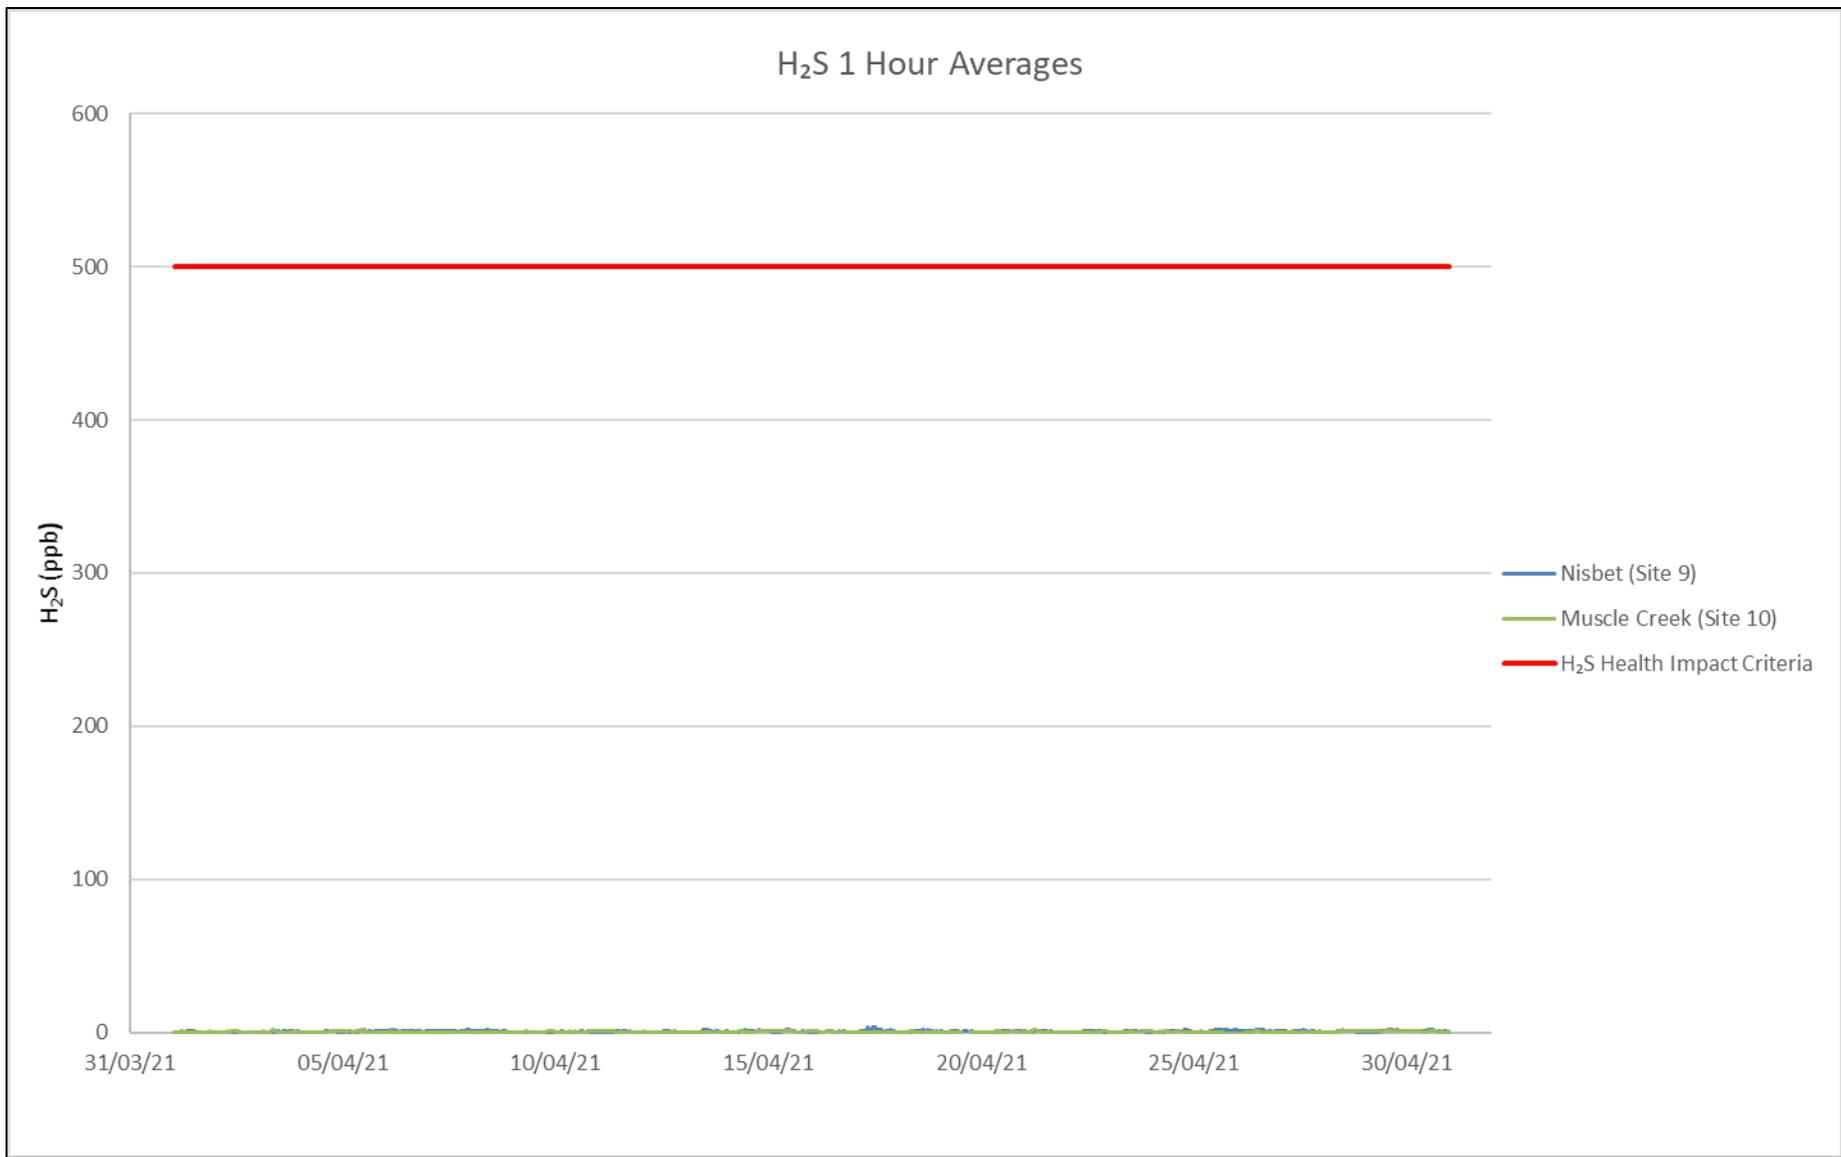


Figure 5: Hydrogen Sulphide 1 Hour Results

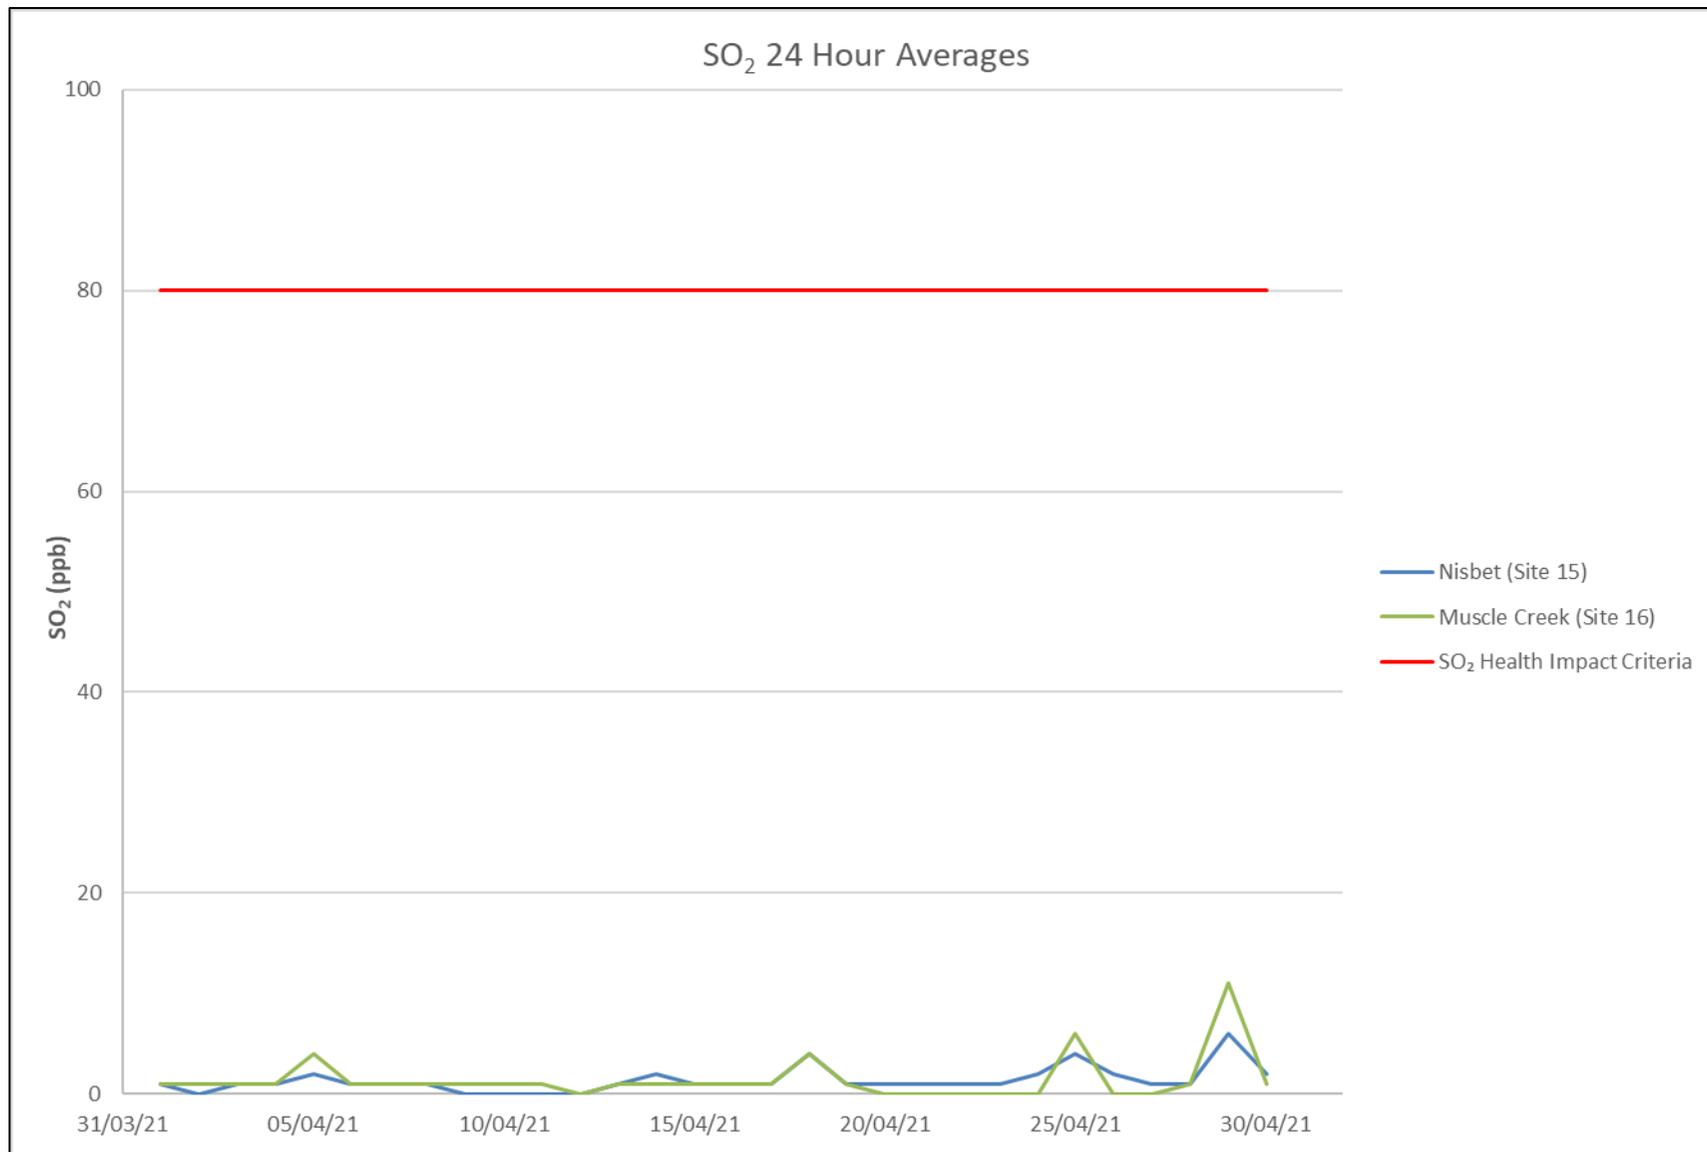


Figure 6: Sulphur Dioxide 24 Hour Results

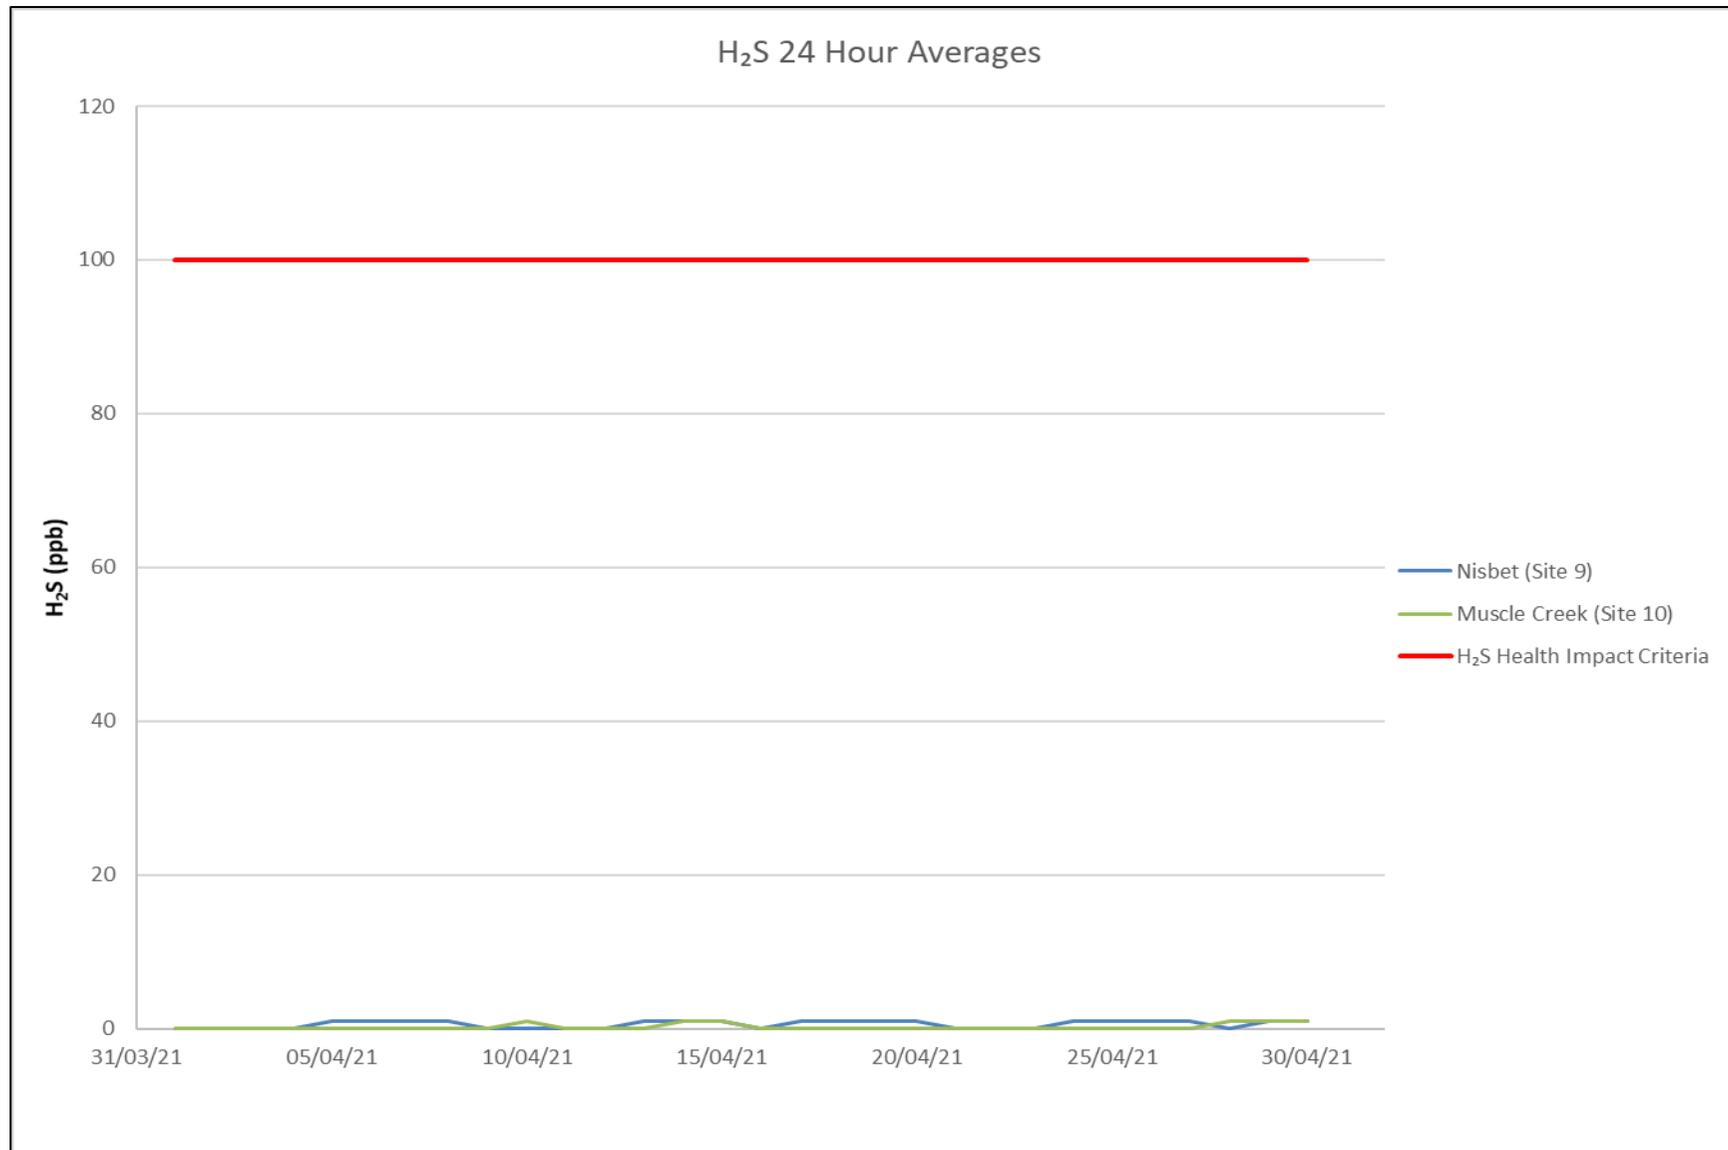


Figure 7: Hydrogen Sulphide 24 Hour Results



#### **4.0 RESPONSE TO ELEVATED GAS LEVELS**

When MCC receive an alarm that the hydrogen sulphide levels at the gas monitors are above the odour threshold of 8ppb and a review of operations and gas sources in the local area is undertaken. There were no alarms recorded for the reporting period in April 2021.

#### **5.0 CORRELATION BETWEEN MANAGEMENT ACTIVITIES AND GAS LEVELS**

A review of the correlation between spontaneous combustion management activities, gas levels has been undertaken. This review found that spontaneous combustion management activities were occurring and gas levels during the reporting period were generally low. All necessary prevention and management controls for spontaneous combustion were being undertaken to reduce spontaneous combustion emissions.

#### **6.0 CORRELATION BETWEEN COMMUNITY COMPLAINTS AND GAS LEVELS**

There were no complaints received during the reporting period.