



**Muswellbrook Coal Company Limited**

**Spontaneous Combustion Report**

**For: Environmental Protection Licence 656**

**Reporting Period: July 2020**

**Authority Holder: Muswellbrook Coal Company Limited**

**Report Date: 24 August 2020**

**Approved by: Julie Thomas  
Environmental Superintendent**



## Table of Contents

<b>1.0 INTRODUCTION.....</b>	<b>2</b>
<b>2.0 SPONTANEOUS COMBUSTION MANAGEMENT MEASURES.....</b>	<b>2</b>
<b>3.0 GAS MONITORING RESULTS .....</b>	<b>5</b>
<b>4.0 RESPONSE TO ELEVATED GAS LEVELS.....</b>	<b>13</b>
<b>5.0 CORRELATION BETWEEN MANAGEMENT ACTIVITIES AND GAS LEVELS .....</b>	<b>13</b>
<b>6.0 CORRELATION BETWEEN COMMUNITY COMPLAINTS AND GAS LEVELS .....</b>	<b>13</b>

## List of Tables

Table 1: Spontaneous Combustion Management Measures.....	2
Table 2: Classification of Spontaneous Combustion Outbreaks .....	4
Table 3: Summary of Spontaneous Combustion .....	4
Table 4: Data Capture Rates.....	5
Table 5: Actions Taken in Response to Elevated Gas Levels.....	13

## List of Figures

Figure 1: Location of Spontaneous Combustion Outbreaks in Open Cut 1.....	6
Figure 2: Location of Spontaneous Combustion Outbreaks in Open Cut 2.....	7
Figure 3: Hydrogen Sulphide 30 Minute Results .....	8
Figure 4: Sulphur Dioxide 1 Hour Results .....	9
Figure 5: Hydrogen Sulphide 1 Hour Results .....	10
Figure 6: Sulphur Dioxide 24 Hour Results .....	11
Figure 7: Hydrogen Sulphide 24 Hour Results .....	12

## 1.0 INTRODUCTION

The coal seams mined by the Muswellbrook Coal Company (MCC) operations are the Greta Coal Measures. These measures have a history of spontaneous combustion. Spontaneous combustion has been a long-term issue at MCC since the first operation commenced in 1907.

A Spontaneous Combustion Management Plan (SCMP) has been prepared according to the specific requirements of the Development Consent. The main objective of the SCMP is to minimise the occurrence of spontaneous combustion and manage the effect by identification, control, removal, mitigation and prevention in the following areas:

- Existing open cut and underground workings;
- Drilling and blasting;
- Mining of overburden;
- Mining of coal;
- Emplacement of overburden;
- Emplacement of washery reject; and
- Coal stockpiles.

The Environment Protection Authority (EPA) require MCC to provide reports on spontaneous combustion management and monitoring on a monthly basis. This report identifies:

- Spontaneous combustion management during the reporting period;
- Gas monitoring results;
- Number of complaints relating to spontaneous combustion;
- Response to hydrogen sulphide levels above the odour threshold; and
- Correlation between spontaneous combustion on site with gas results and complaints received.

## 2.0 SPONTANEOUS COMBUSTION MANAGEMENT MEASURES

The daily spontaneous combustion management measures for the reporting period are shown in **Table 1**.

**Table 1: Spontaneous Combustion Management Measures**

Date	Water Sprays	Water Carts Assisting	Capping	Hot Material Removal	Comments
01/07/20	-	OC1 Dump and S22	-	-	
02/07/20	-	OC1	-	-	
03/07/20	-	OC1	-	-	
04/07/20	-	OC1	-	-	
05/07/20	-	-	RL 165 Dump	-	
06/07/20	-	S22	-	-	
07/07/20	-	OC1	S22	-	



Date	Water Sprays	Water Carts Assisting	Capping	Hot Material Removal	Comments
08/07/20	-	S22	-	S22	
09/07/20	-	OC1	-	-	
10/07/20	-	OC1	-	-	
11/07/20	-	OC1	-	-	Wet Weather
12/07/20	-	OC1	-	S22	Wet Weather
13/07/20	-	OC1 Dump and S22	-	-	
14/07/20	-	OC1	-	-	Wet Weather
15/07/20	-	OC1, OC1 Dump and S22	-	-	
16/07/20	-	OC1	-	-	
17/07/20	-	OC1	RL264 Dump	-	
18/07/20	-	OC1	-	-	
19/07/20	-	OC1	-	-	
20/07/20	-	OC1	-	S22	
21/07/20	-	OC1	-	S22	
22/07/20	-	OC1 and OC1 Dump	-	S22	
23/07/20	-	OC1	-	S22	
24/07/20	-	S22	-	S22	
25/07/20	-	OC1	-	S22	Wet Weather
26/07/20	-	OC1	-	S22	Wet Weather
27/07/20	-	OC1	-	S22	Wet Weather
28/07/20	-	OC1	-	-	Wet Weather
29/07/20	-	OC1	-	-	Wet Weather
30/07/20	-	OC1	-	-	
31/07/20	-	OC1	-	-	

The classification system for spontaneous combustion outbreaks is provided in **Table 2**. A summary of the areas affected by spontaneous combustion and the areas controlled and treated during the reporting period is provided in **Table 3**. The locations of these areas can be seen in **Figure 1** to **Figure 2**.

**Table 2: Classification of Spontaneous Combustion Outbreaks**

Classification	Description
<b>A</b>	Open flame
<b>B</b>	Visible steam or smoke
<b>C</b>	Other physical evidence of spontaneous combustion (e.g. cracks, coal tars, sulphur crusting, etc)

\* - classification revised in November 2019

**Table 3: Summary of Spontaneous Combustion**

Site Map Location	Classification (A-C)	Affected Area Without Active Control ( $m^2$ )	Active Controls Completed	Area Controlled ( $m^2$ )
Open Cut 1	A	6*	Mining	4,004**
	B	32*	Capping	34**
	C	14*	Infusion	0**
Open Cut 2	N/A	0*	None Required	0**
<b>SUMMARY</b>				
Total Area Affected		52*		
Total Area Controlled		4,038**		

\* - at end of reporting period

\*\* - during reporting period

No spontaneous combustion outbreaks were observed in Open Cut 2 throughout July 2020. Therefore, no active controls were implemented in Open Cut 2.

### 3.0 GAS MONITORING RESULTS

The gas monitoring results are displayed graphically in **Figure 3** to **Figure 7**. As noted in these graphs, there were no results above the health impact assessment criteria for the reporting period. However, there was one occasion in the reporting period where H<sub>2</sub>S was above the odour threshold and an alarm was received. This alarm was received on 24<sup>th</sup> July 2020 at 7:48am at Muscle Creek (Site 10).

The data capture rates for the reporting period and the last 12 months are shown in **Table 4**.

**Table 4: Data Capture Rates**

Monitoring Location	Pollutant	Averaging Period	Data Capture – July (%)	Data Capture – 12 Month Rolling (%)
Point 9, Nisbet	Hydrogen Sulphide	30 minutes	94.9	92.3
		1 hour	94.0	91.2
		24 hours	96.8	94.8
Point 10, Muscle Creek	Hydrogen Sulphide	30 minutes	95.0	95.1
		1 hour	94.0	93.8
		24 hours	96.8	98.1
Point 15, Nisbet	Sulphur Dioxide	1 hour	94.5	<b>89.4</b>
		24 hours	96.8	92.9
Point 16, Muscle Creek	Sulphur Dioxide	1 hour	94.0	94.0
		24 hours	96.8	98.4

Data capture for all monitoring sites was 90% or higher during July 2020. However, the data capture 12-month rolling average for sulphur dioxide at Nisbet (Site 15) remained less than 90% due to the previous outages in February and May 2020.

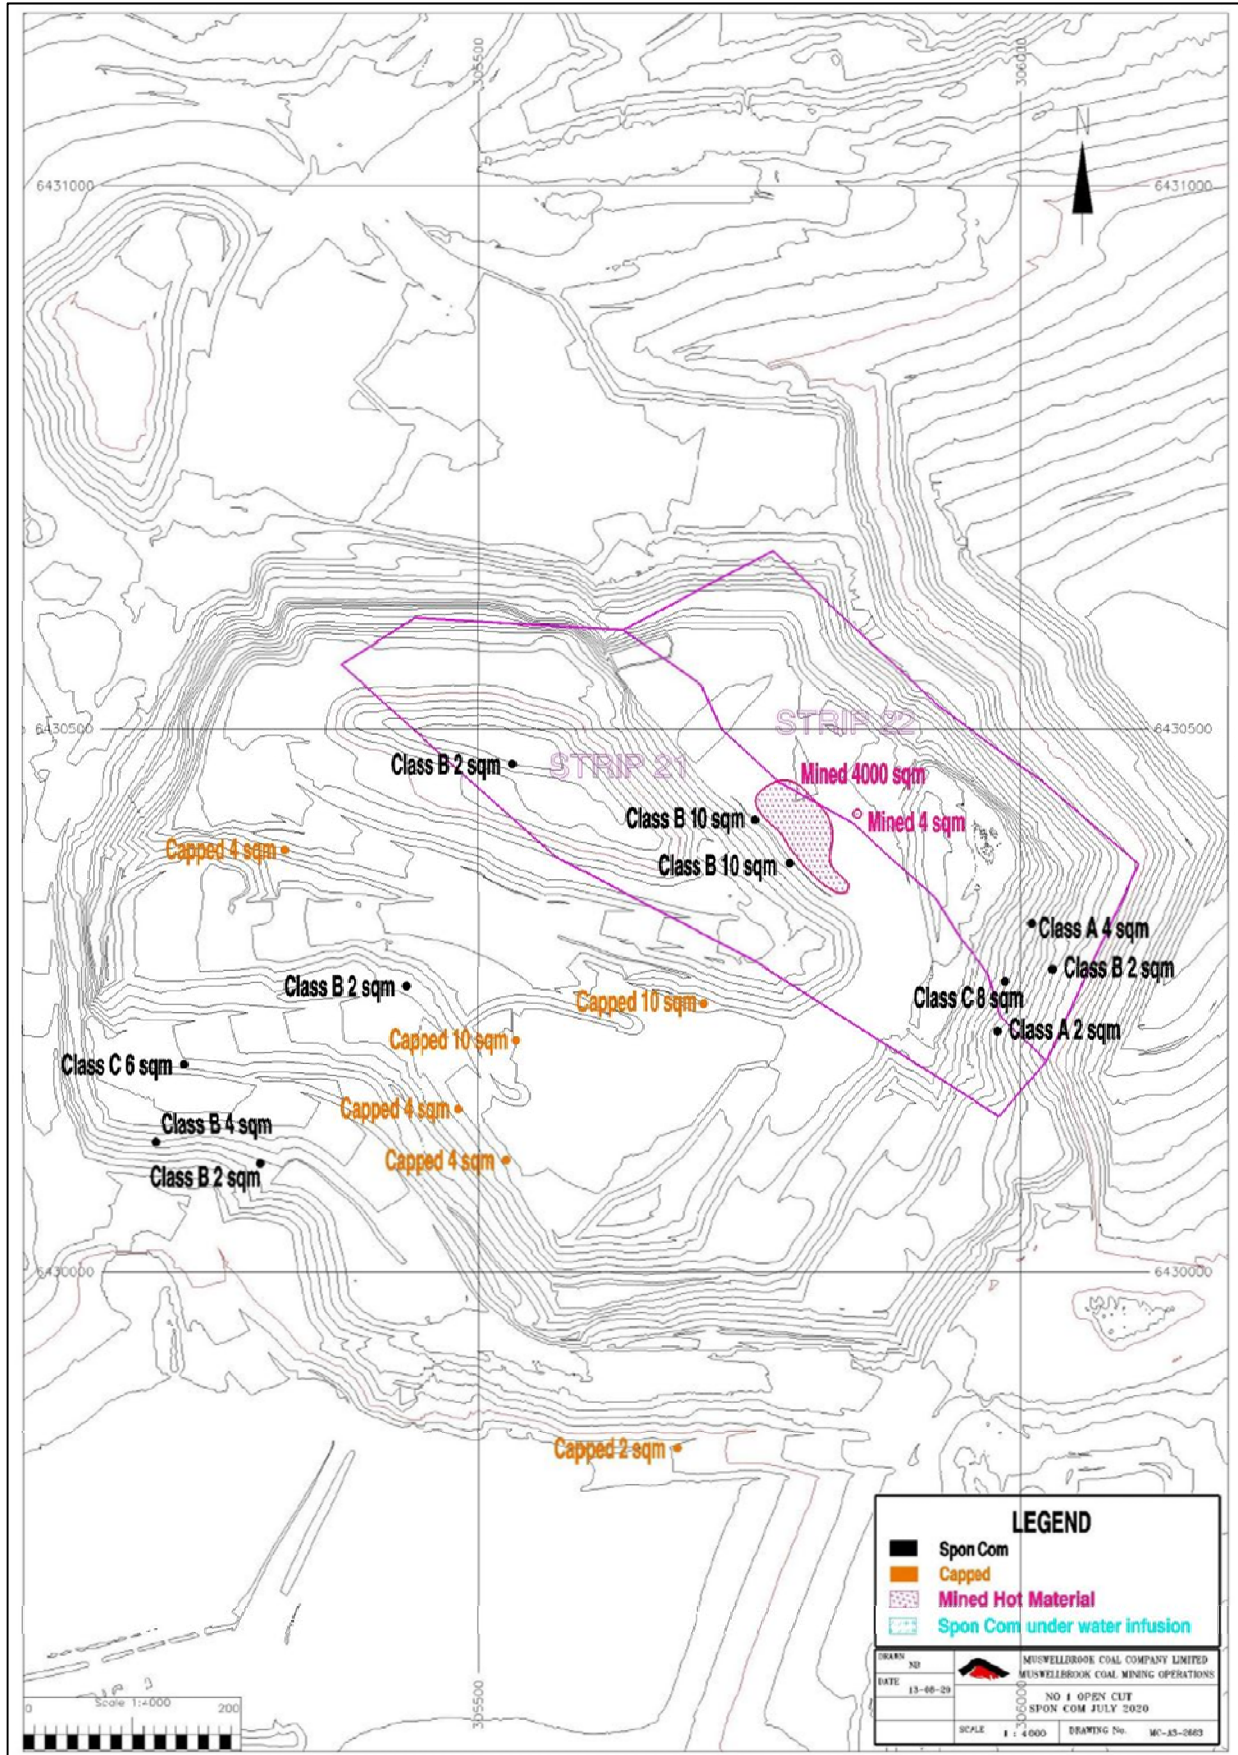


Figure 1: Location of Spontaneous Combustion Outbreaks in Open Cut 1

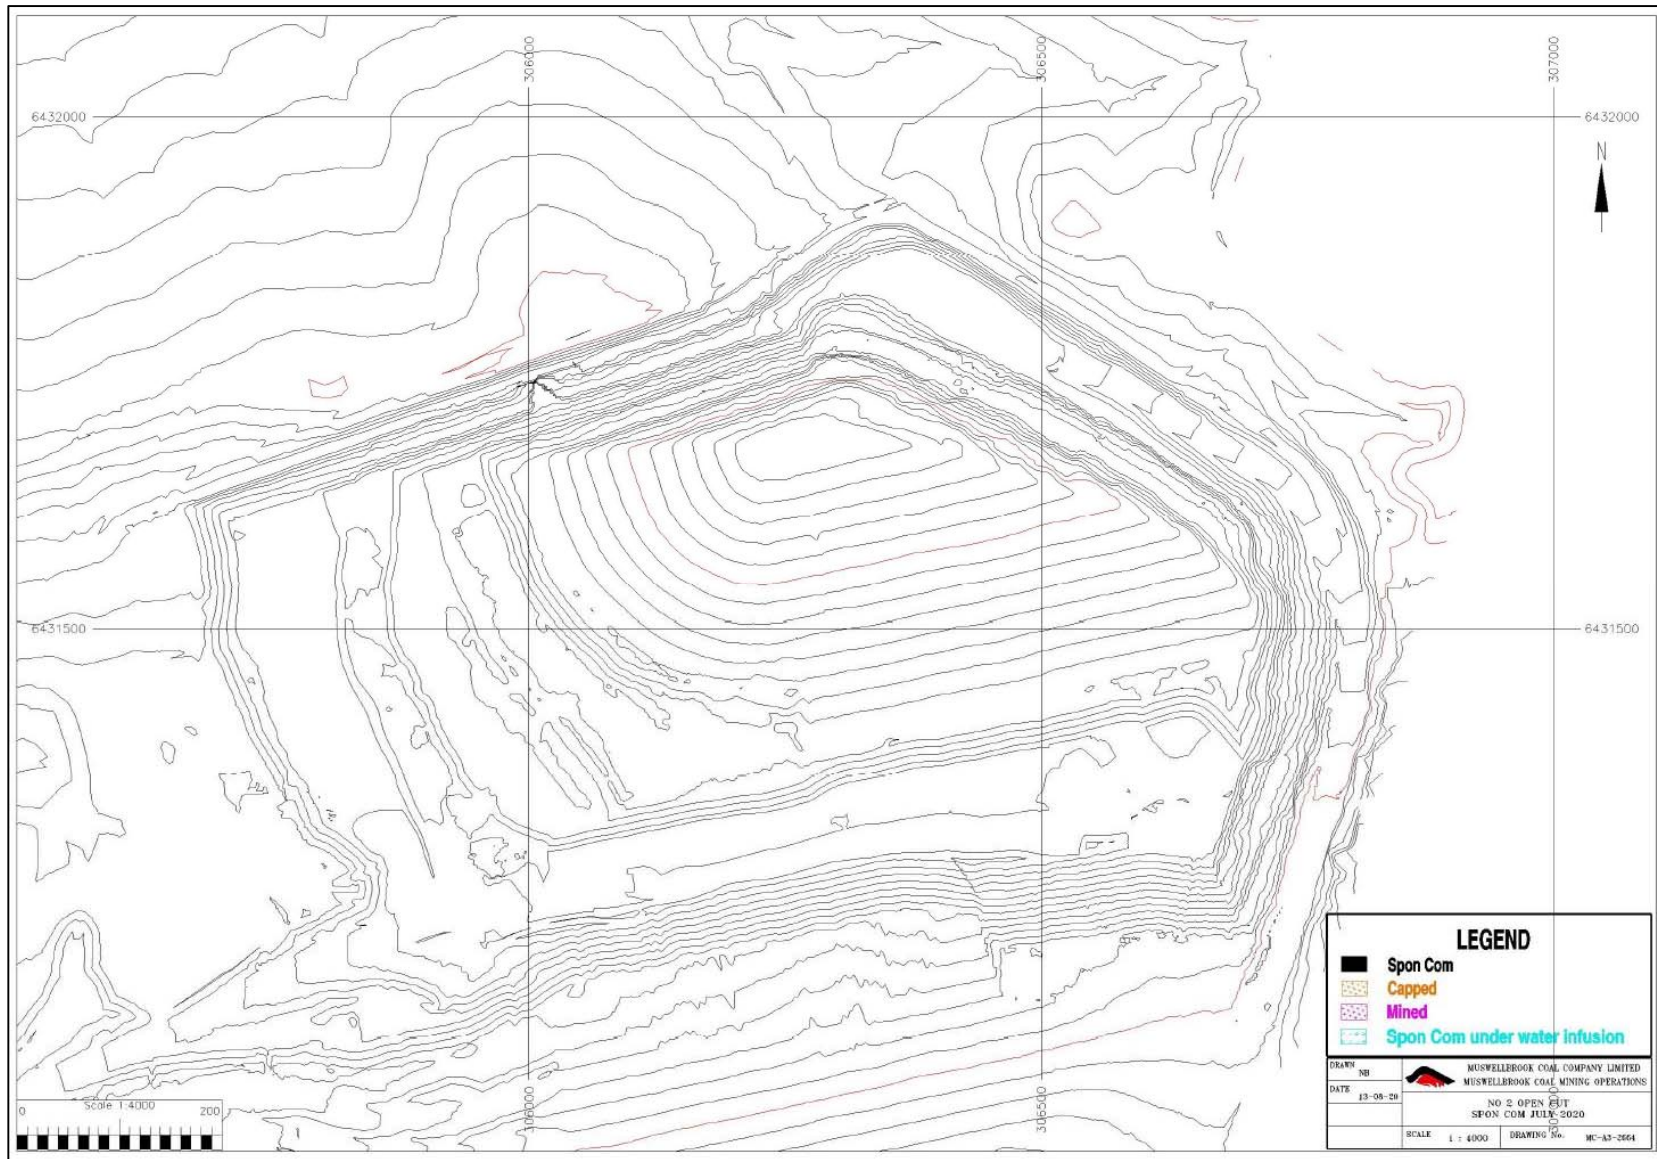


Figure 2: Location of Spontaneous Combustion Outbreaks in Open Cut 2



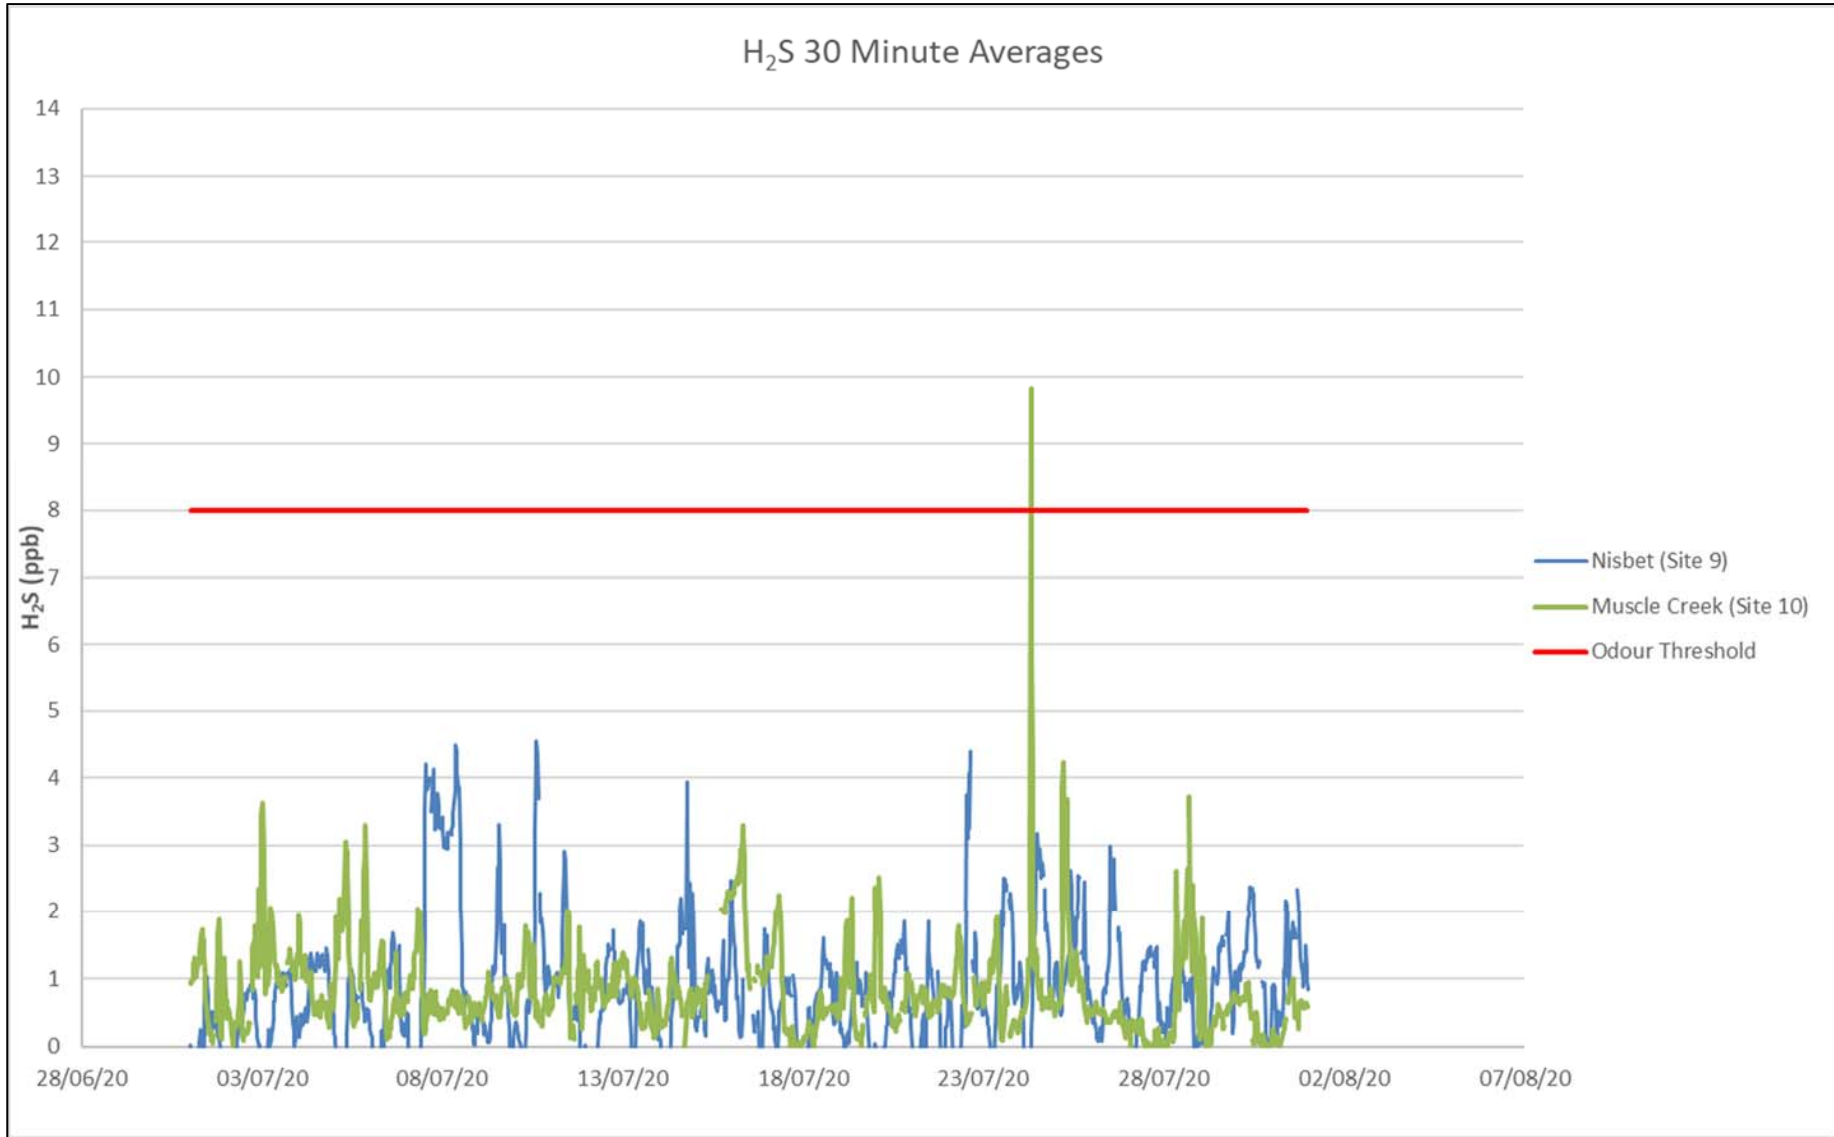


Figure 3: Hydrogen Sulphide 30 Minute Results

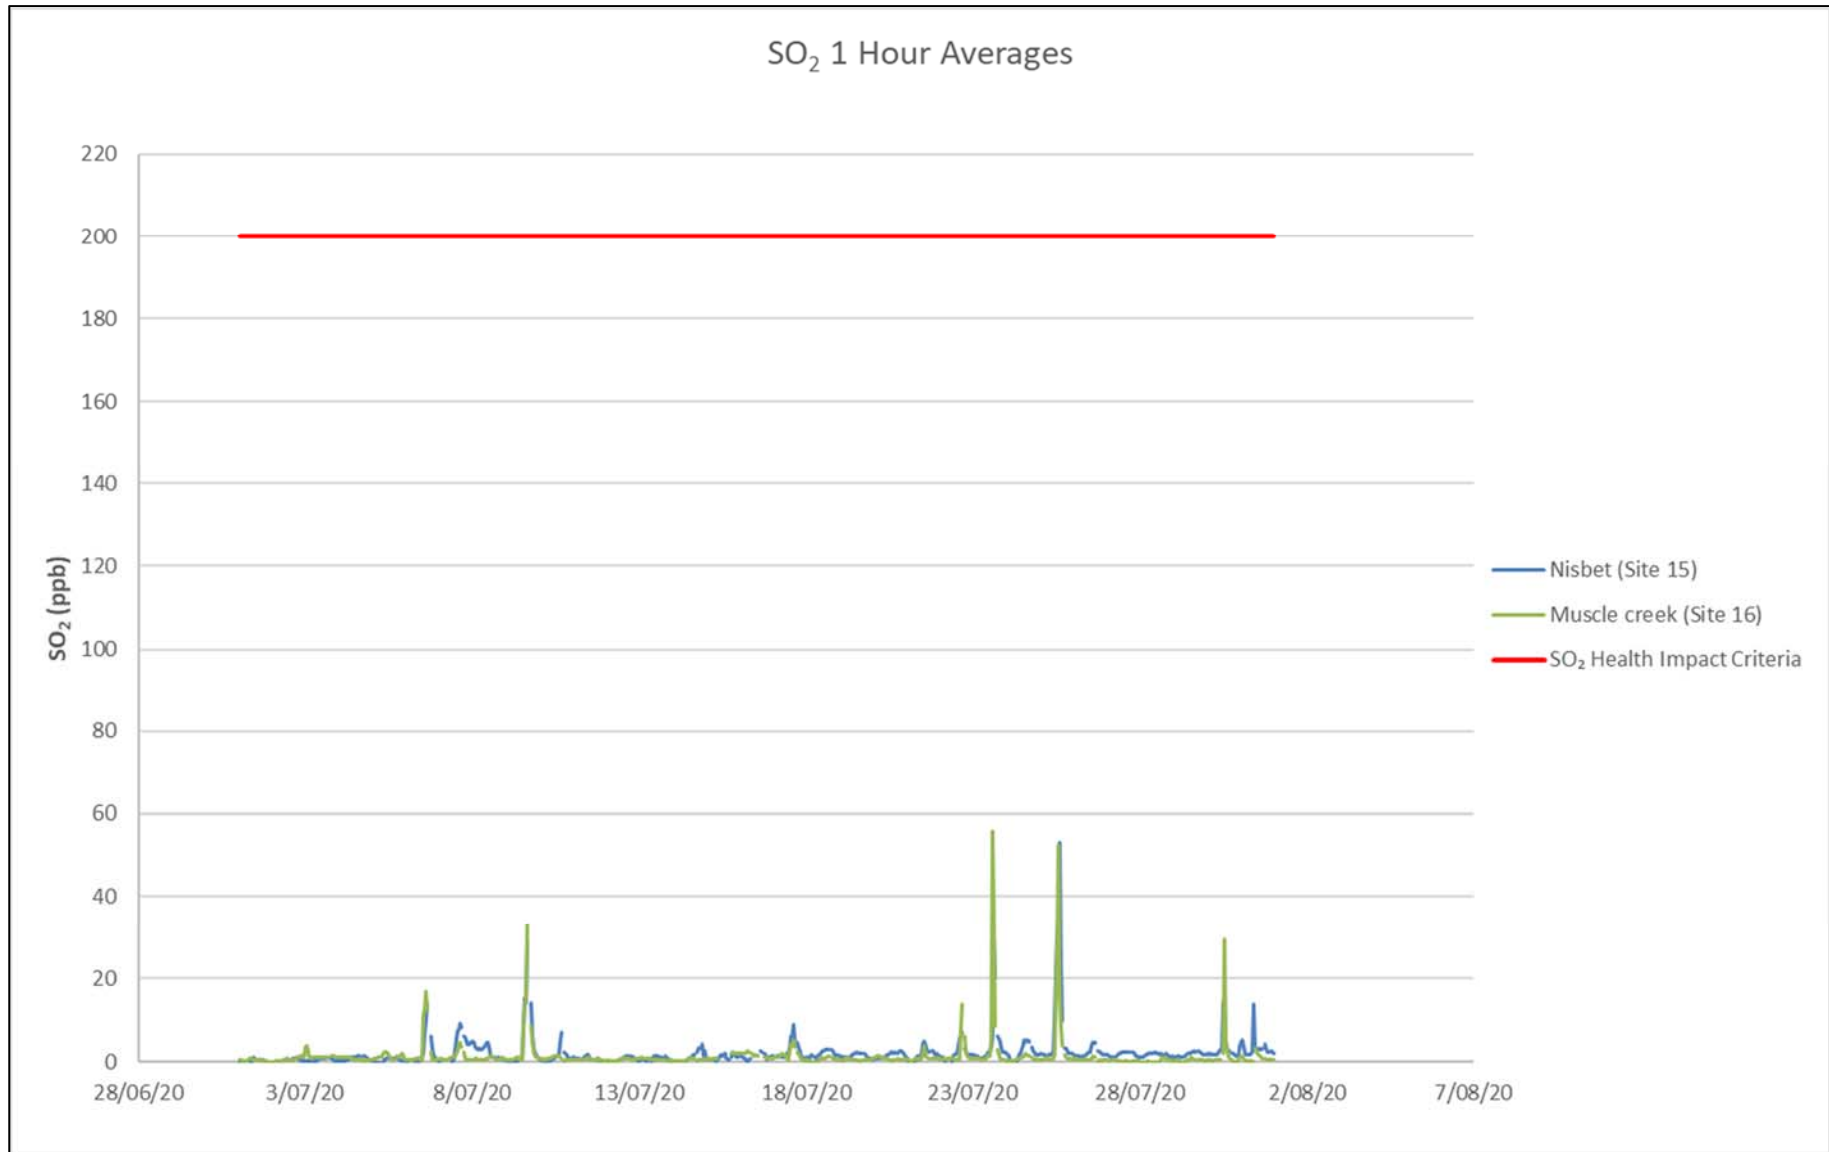


Figure 4: Sulphur Dioxide 1 Hour Results

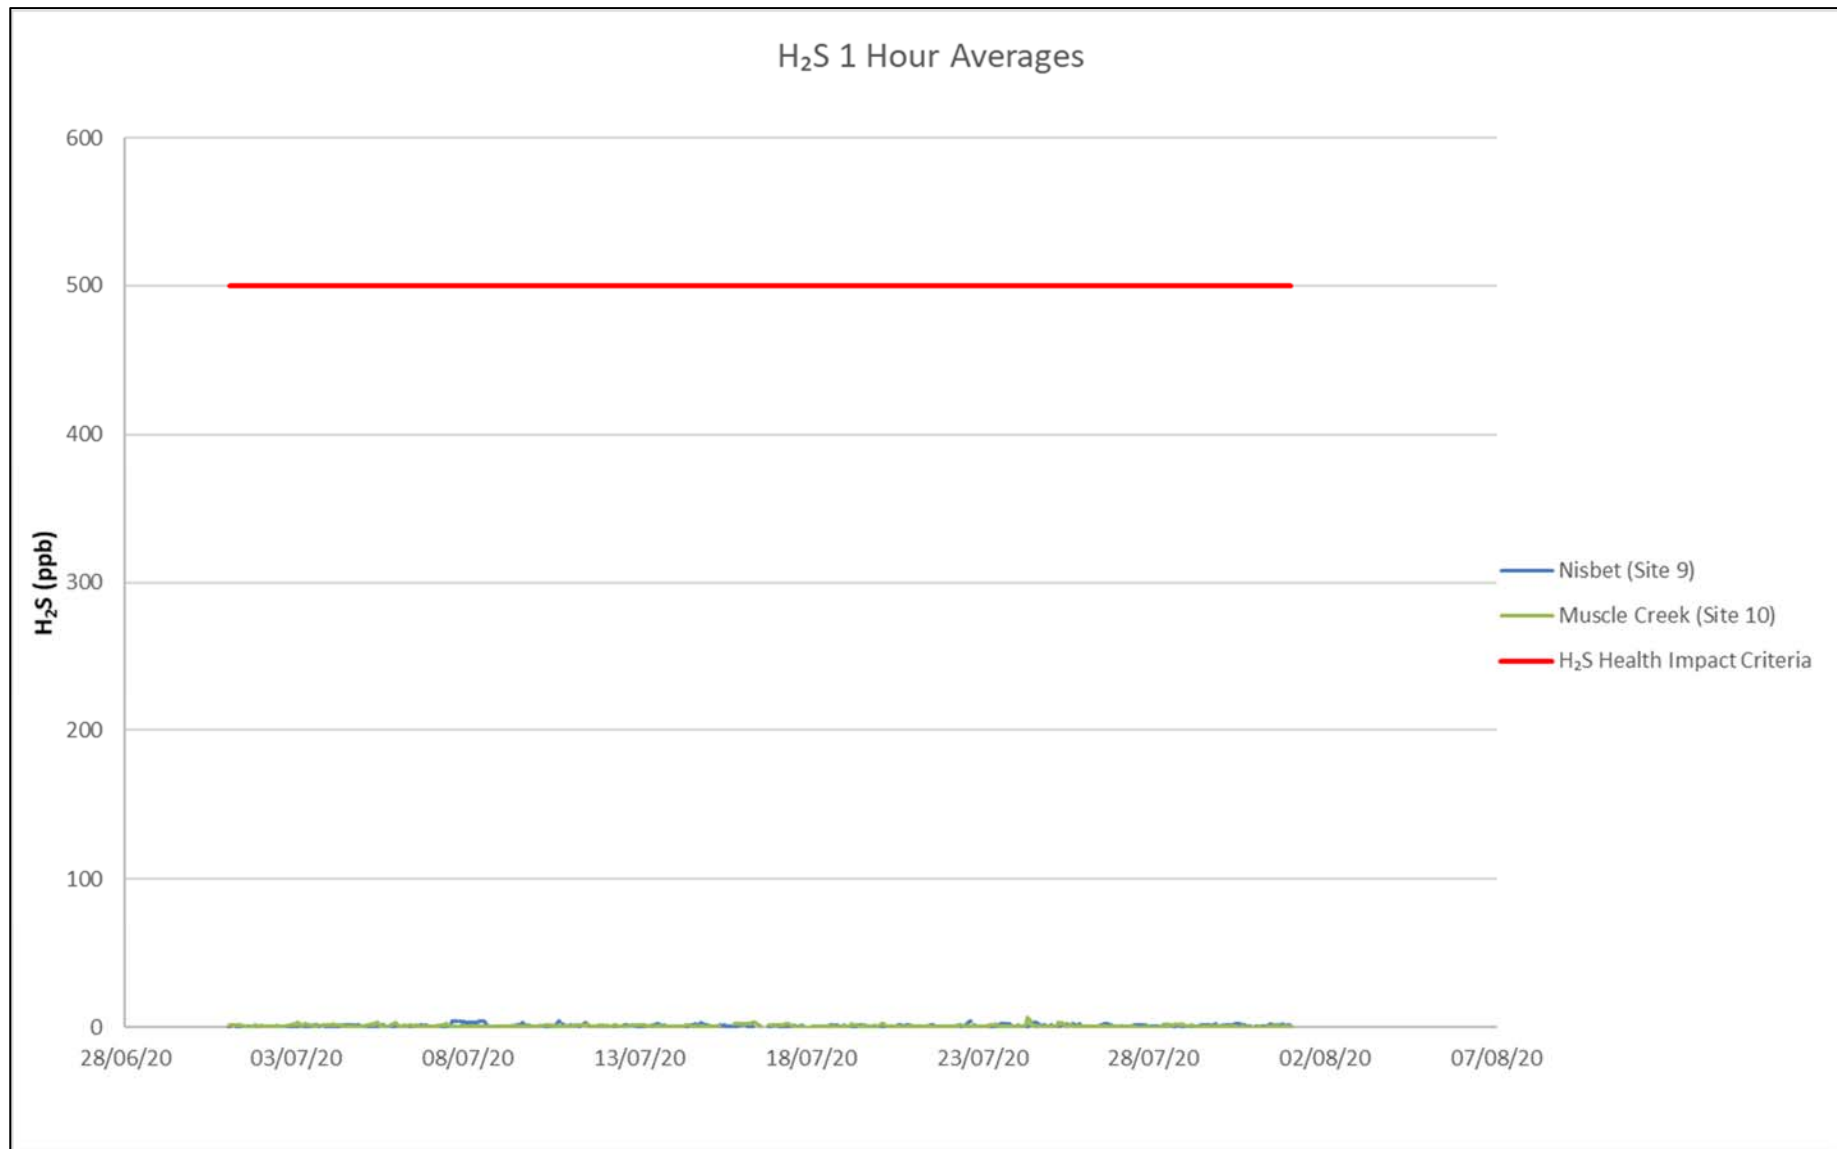


Figure 5: Hydrogen Sulphide 1 Hour Results

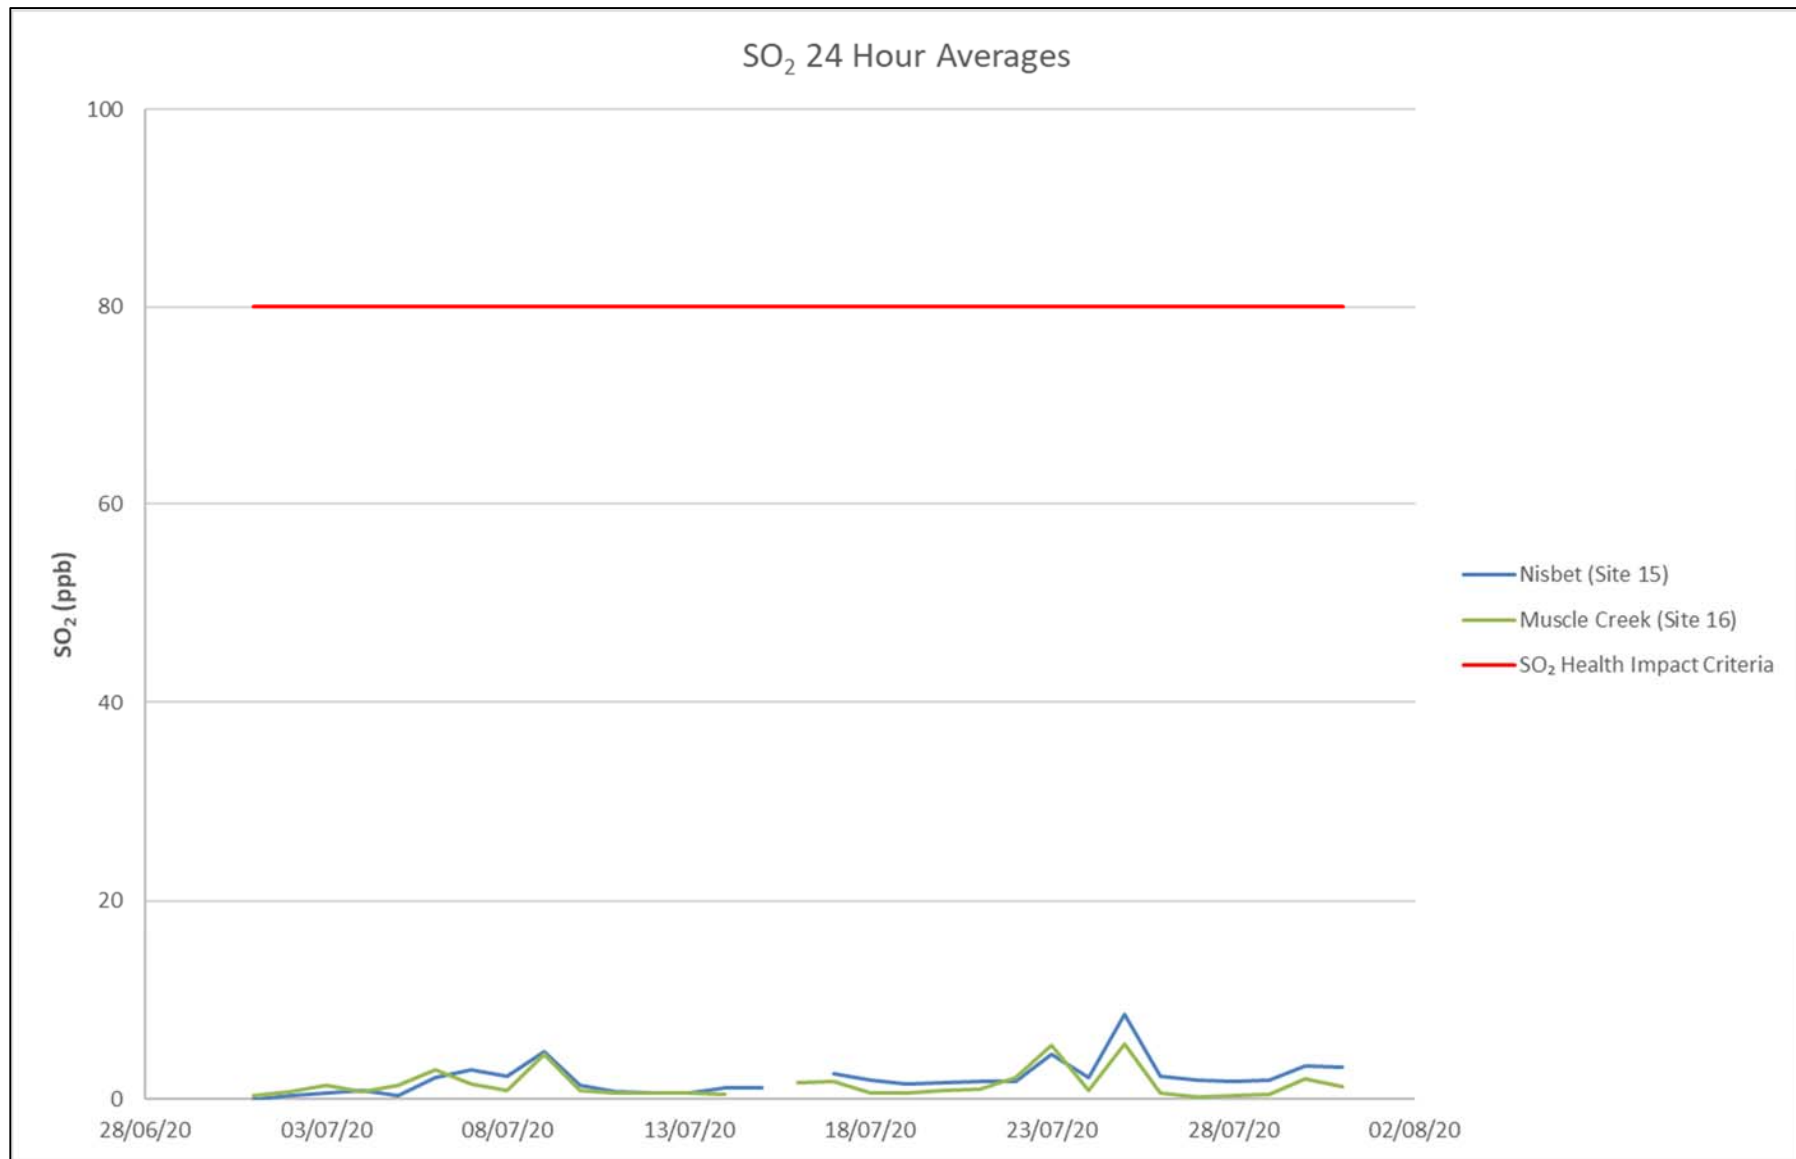


Figure 6: Sulphur Dioxide 24 Hour Results

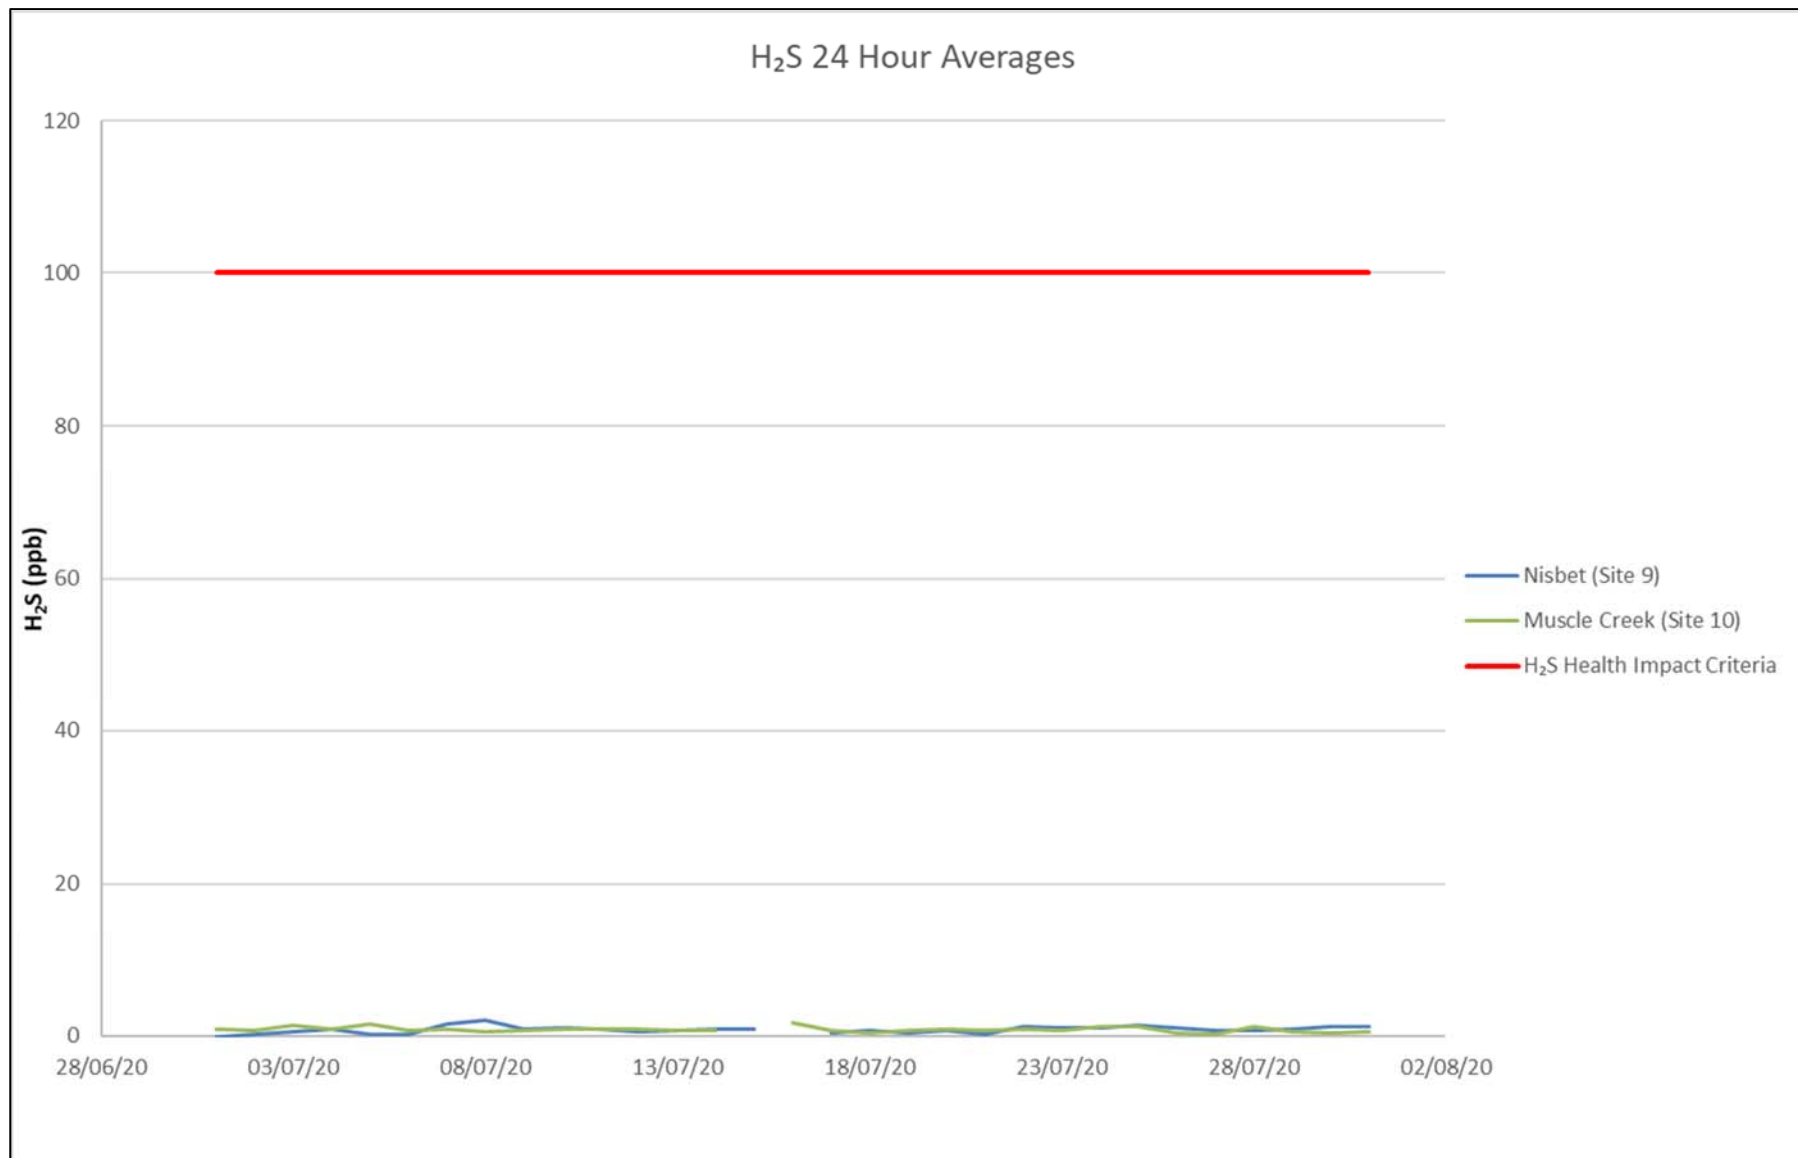


Figure 7: Hydrogen Sulphide 24 Hour Results

#### 4.0 RESPONSE TO ELEVATED GAS LEVELS

When MCC receive an alarm that the hydrogen sulphide levels at the gas monitors are above the odour threshold of 8ppb, a review of operations and gas sources in the local area is undertaken. The responses to any alarms received during the reporting period are shown in Table 5.

**Table 5: Actions Taken in Response to Elevated Gas Levels**

<b>Date and Time of Alarm</b>	<b>Location of Alarm</b>	<b>Weather Conditions at Time of Alarm</b>	<b>Response to Alarm</b>	<b>Classification of Spontaneous Combustion</b>
24/07/2020 7:48am	Muscle Creek	Wind speed = 0.9 m/s from the north east. No rainfall but there was low cloud cover and fog throughout the morning.	Hot material had been exposed in S22 on the morning of the alarm. The OCE's responded by cooling the hot areas with the watercart and removing the hot material using a digger.	Combination of Class A, B and C.

#### 5.0 CORRELATION BETWEEN MANAGEMENT ACTIVITIES AND GAS LEVELS

A review of the correlation between spontaneous combustion management activities, gas levels and complaints has been undertaken. This review has found that spontaneous combustion management activities were occurring throughout the reporting period and gas levels during the reporting period were generally low. Spontaneous combustion management activities were being undertaken at the time of the elevated gas levels on 24<sup>th</sup> July 2020.

#### 6.0 CORRELATION BETWEEN COMMUNITY COMPLAINTS AND GAS LEVELS

There were no complaints related to odour impacts from spontaneous combustion received during the reporting period.